

# CROFT, LLC

## TEST REPORT

**SCOPE OF WORK**

AAMA/WDMA/CSA 101/I.S.2/A440 TESTING ON SERIES 75 ALUMINUM HORIZONTAL SLIDER

**REPORT NUMBER**

I7045.01-801-44 R0

**TEST DATE(S)**

07/24/18 - 08/01/18

**ISSUE DATE**

09/06/18

**RECORD RETENTION END DATE**

08/01/22


**PAGES**

24

**DOCUMENT CONTROL NUMBER**

RT-R-AMER-Test-2804 (04/17/18)

© 2017 INTERTEK

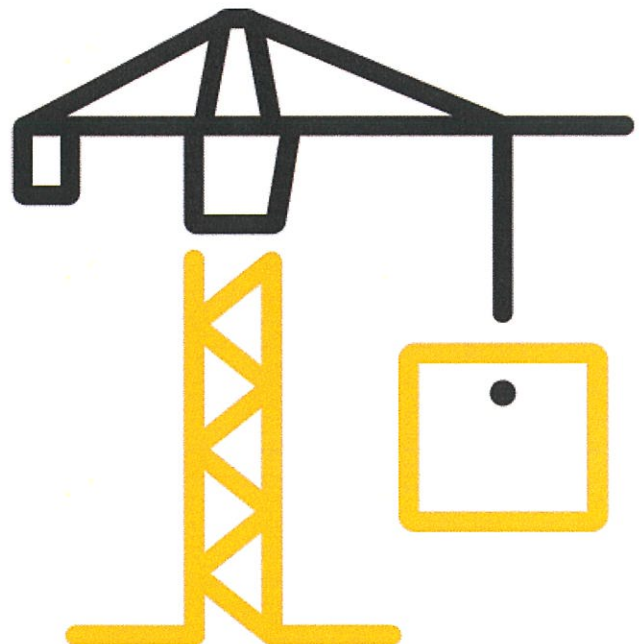

## TEST REPORT FOR CROFT, LLC

Report No.: I7045.01-801-44 R0

Date: 09/06/18

### REPORT ISSUED TO

**CROFT, LLC**

107 Oliver Emmerich Drive  
McComb, Mississippi

### SECTION 1

#### SCOPE

Intertek Building & Construction (B&C) was contracted by Croft, LLC to perform testing in accordance with AAMA/WDMA/CSA 101/I.S.2/A440 on their Series 75 Aluminum Slider. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted at Intertek test facility in Plano, TX. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

### SECTION 2

#### SUMMARY OF TEST RESULTS

TITLE	RESULTS
AAMA/WDMA/CSA 101/I.S.2/A440-17	R-PG20-HS
Design Pressure	±960 Pa (±20.05 psf)
Air Infiltration	1.25 L/s/m <sup>2</sup> (0.25 cfm/ft <sup>2</sup> )
Water Penetration Resistance Test Pressure	150 Pa (3.13 psf)

Reference must be made to Intertek B&C Report No. I7045.01-801-44, dated 09/06/18 for complete test specimen description and detailed test results.

For INTERTEK B&C:

<b>COMPLETED BY:</b>	Jeffrey Crump Sr. Project Manager – AWS	<b>REVIEWED BY:</b>	Andy Cost Laboratory Manager
<b>TITLE:</b>	AWS	<b>TITLE:</b>	Laboratory Manager
<b>SIGNATURE:</b>	 Jeffrey Crump	<b>SIGNATURE:</b>	 Andy Cost
<b>DATE:</b>	09/06/18	<b>DATE:</b>	09/06/18

JC:cm

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.