



Draft Final Reconfiguration Plan: TO16 RP01

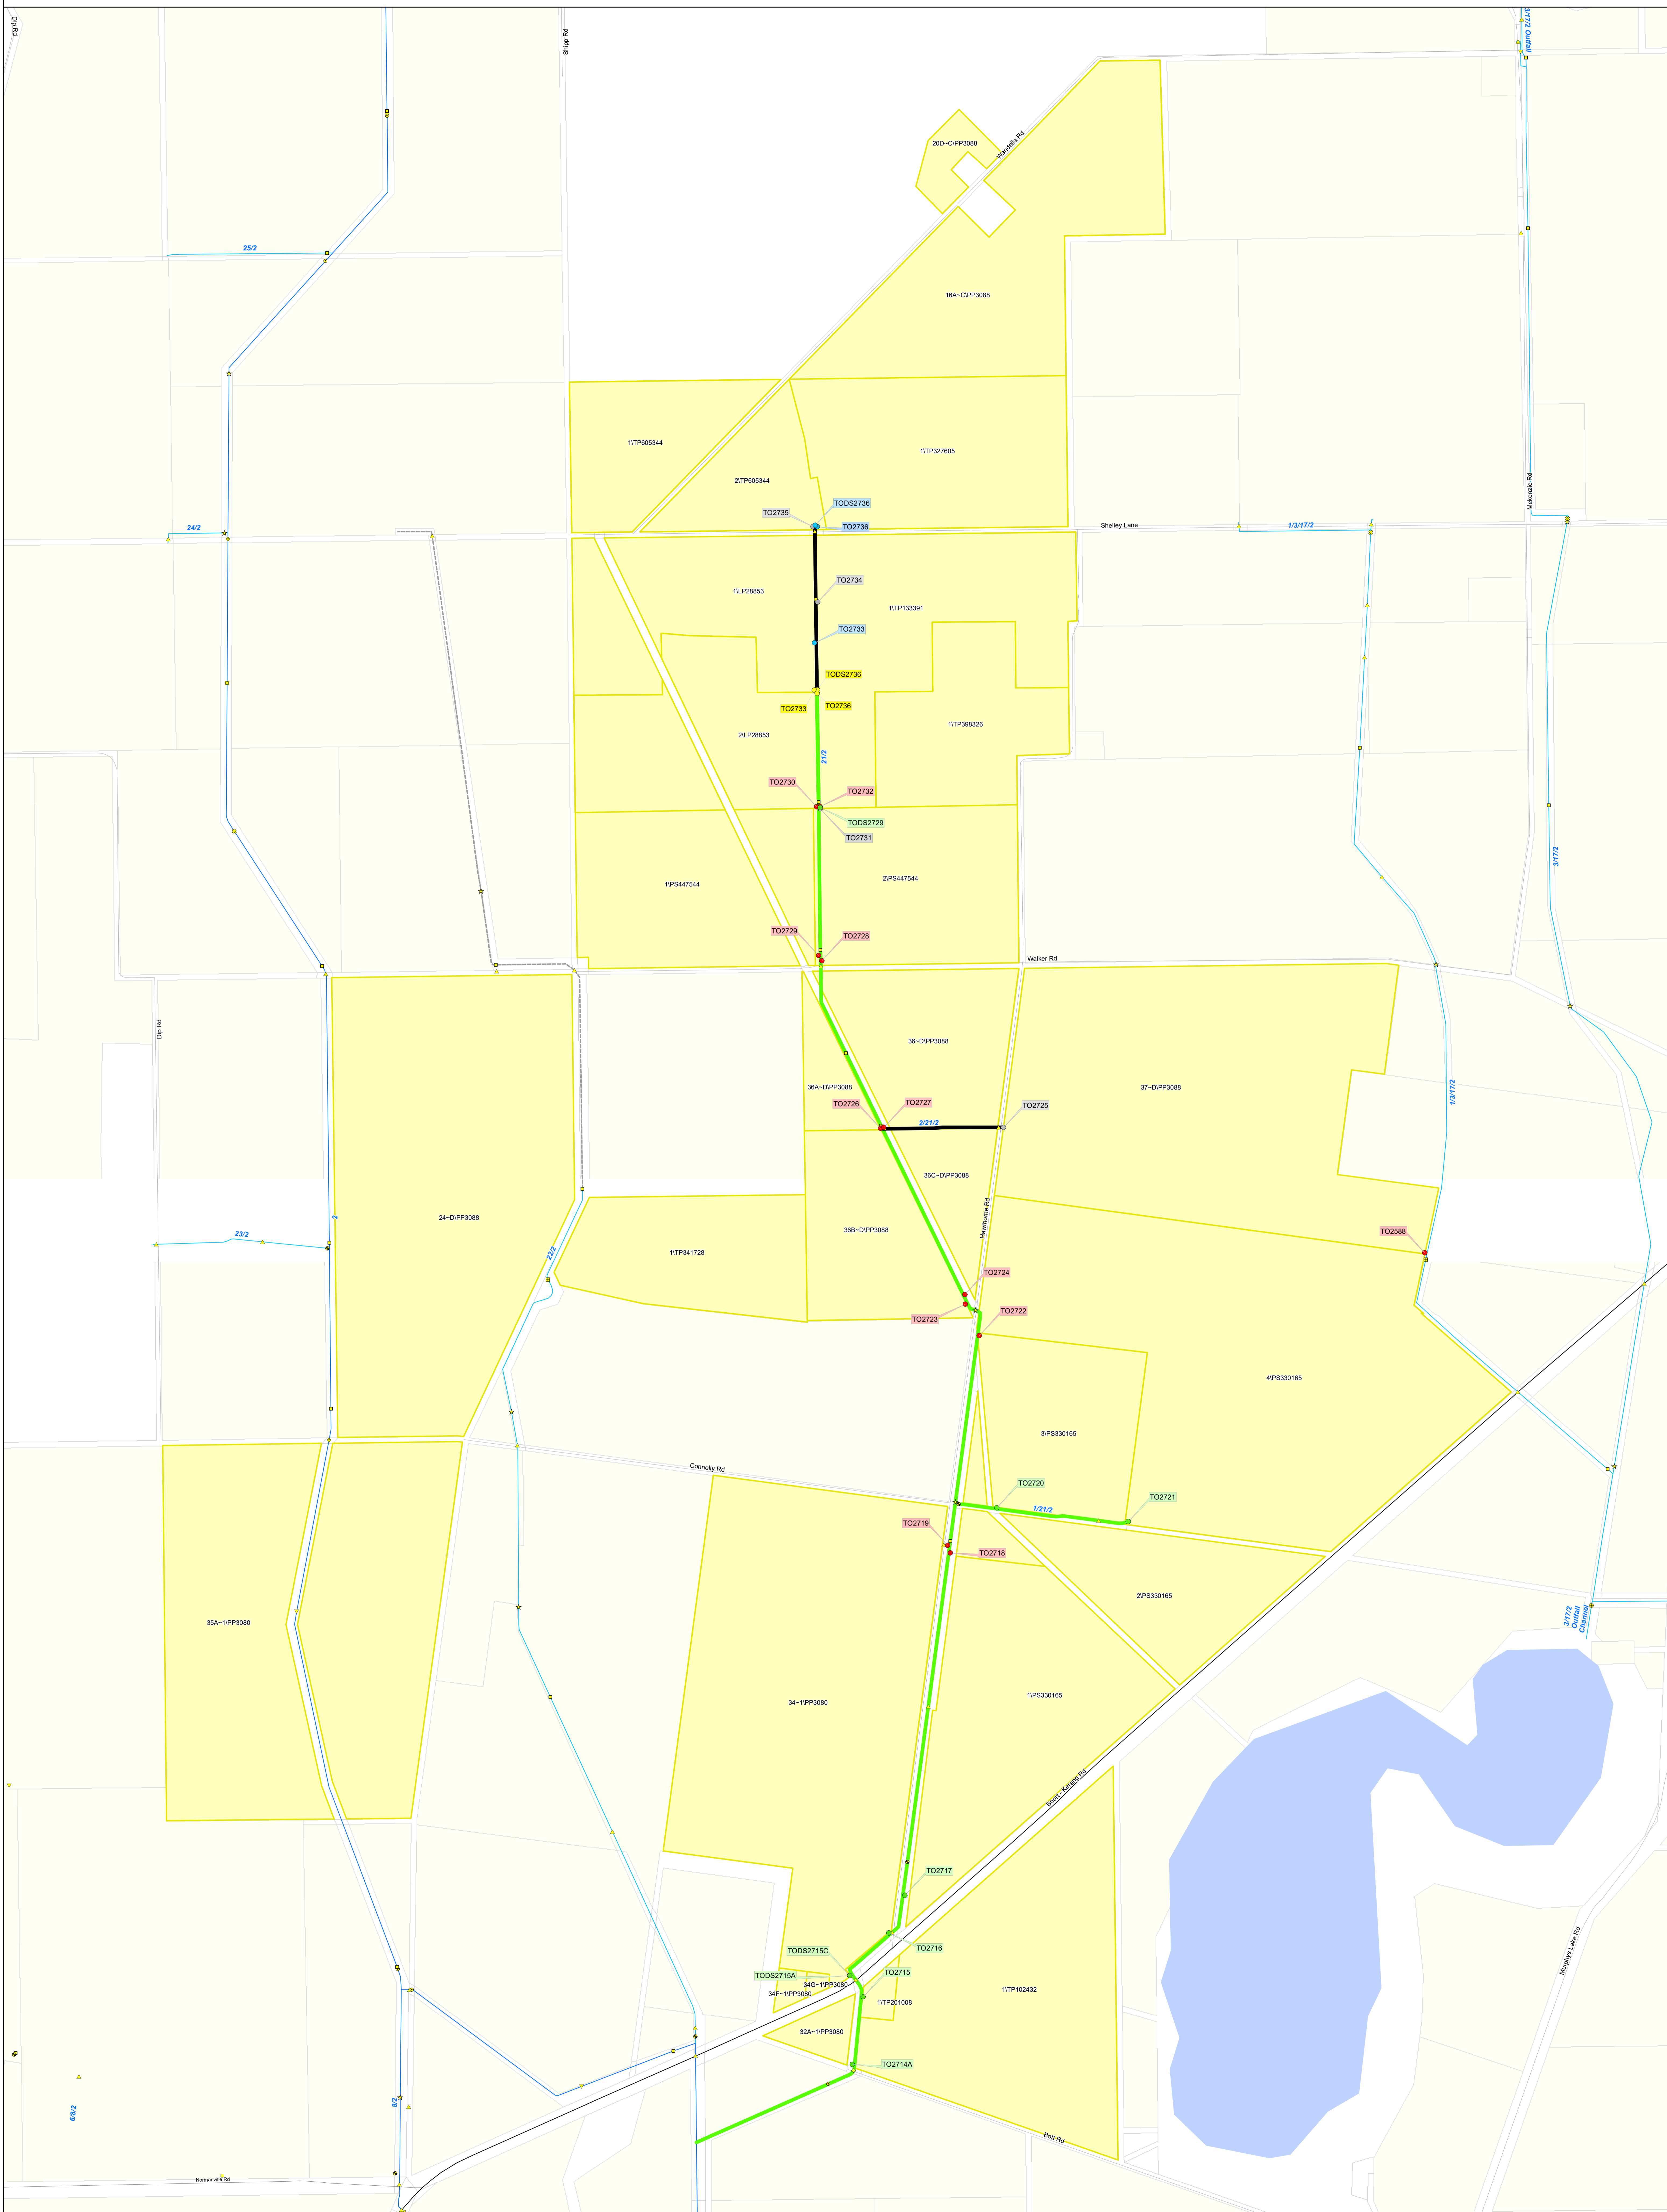

IR185583
18 JUN 2018
COALBURN-MURRAY WATER
40 CASEY STREET (PO BOX 165)
TATURA VIC 3616
Ph (03) 5833 5500 Fax (03) 58245827
gmsupport@gmwwater.com.au

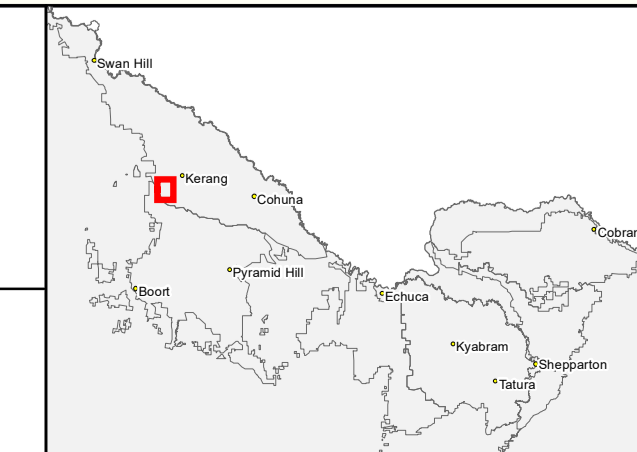

Service Point Modernisation Action	Channel Modernisation Action	G-MW Irrigation Structures	Electrical Crossing	Offtake	Subway	Channel Network	Transport	Waterway
● Retain	— Retain channel with no modernisation	● Abandoned Structure	⚡ Electrical Crossing	◆ Offtake	▭ Subway	— Backbone Channel	— Freeway	— Waterway
● Relocate	— Retain channel with remediation	◆ Bridge	◆ Farm Irrigation Crossing	◆ Outfall	▭ Syphon	— Non-Backbone Channel	— Highway	■ Lake
● Replace	— Retain channel with modernisation	▲ Culvert	◆ Flume	◆ Pump Station	▭ Valve - Isolation	— Decommissioned Channel	— Major Road	■ DCRP Customer Parcels
○ Rationalise	— Pipeline	◆ Drainage Inlet	◆ Footbridge	◆ Regulator	▭ Weir	— Proposed Pipeline	— Semi-Major Road	■ Other Customer Properties
● Relocation Point	— Decommission channel	◆ Monitoring Station	◆ Monitoring Station	◆ Regulator Combine	◆ Weir		— Minor Road	■ Property/Land Not Serviced

SCALE AT A0 1:7,270

0 0.175 0.35 0.7 km

The content of this product is provided for information purposes only. No claim is made as to the accuracy of authenticity of the content of the product. In no event will G-MW, its agents, instrumentalities and employees be liable for the accuracy of the information contained within this product nor its use of reliance placed on it. The information used within this product is provided on the basis that all persons accessing the information undertake responsibility for assessing the relevance and accuracy of its content.