


Reconfiguration Plan: LV16 RP 1

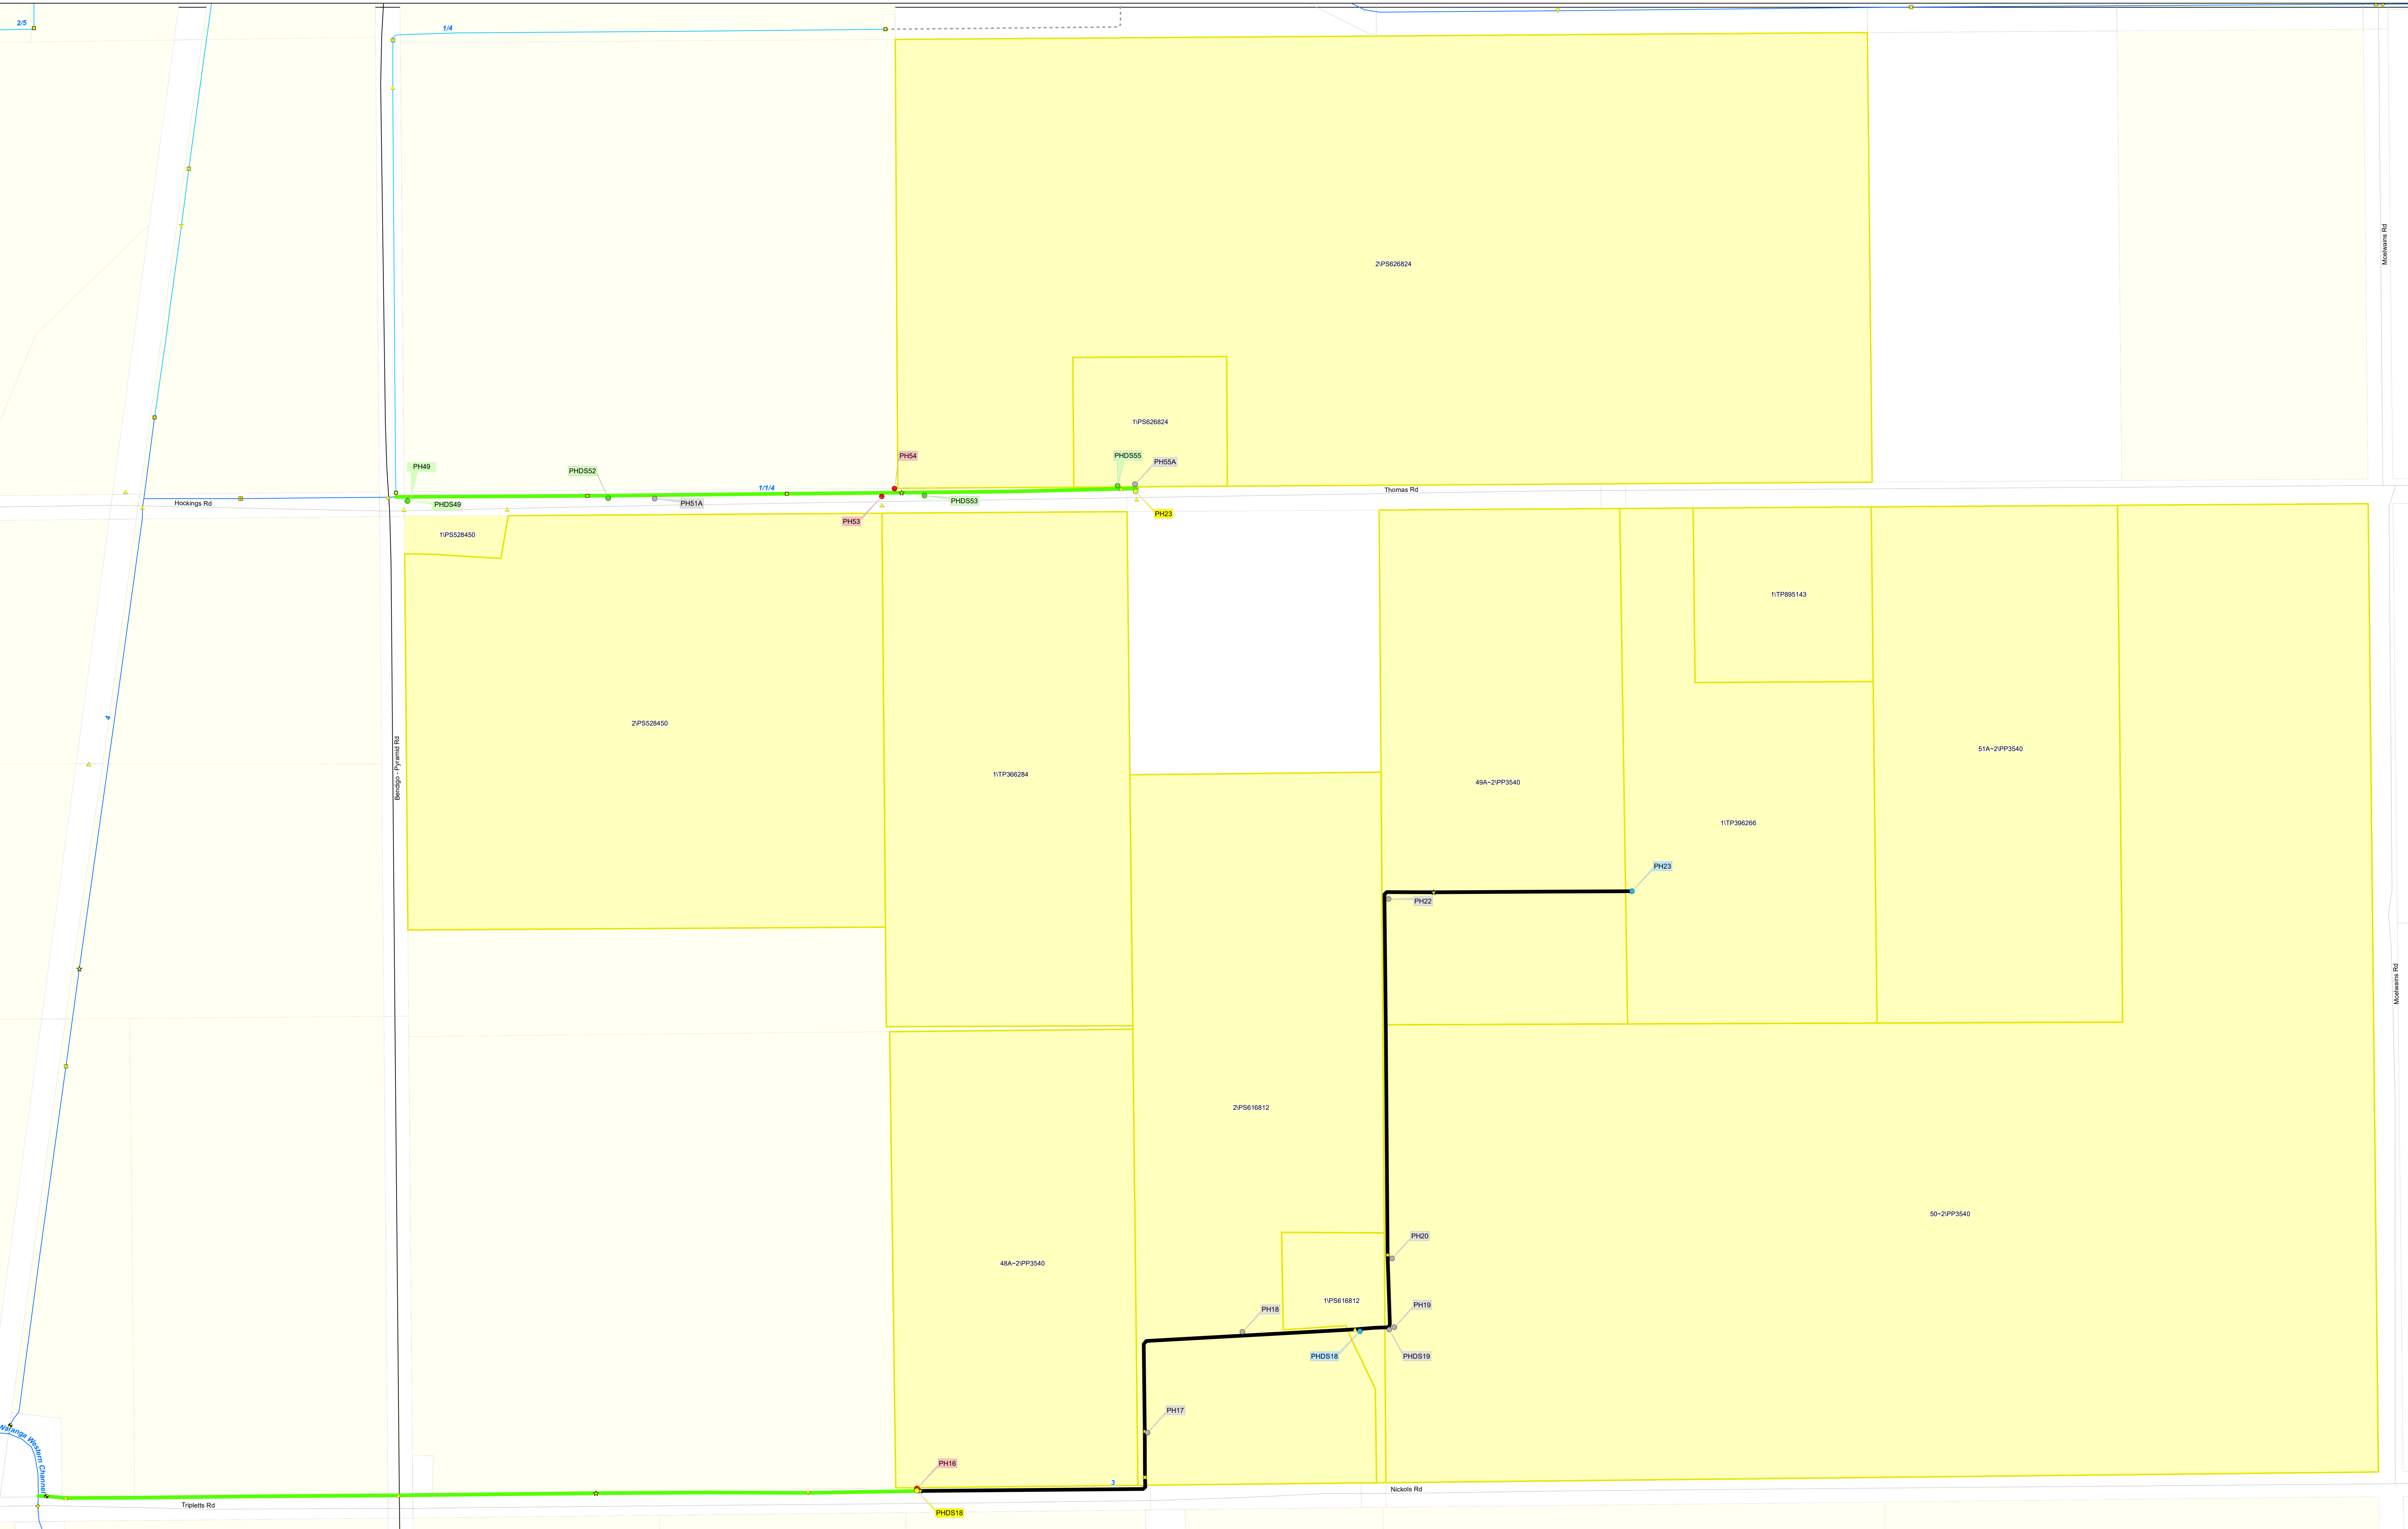

Goulburn-Murray Water
IR185583
30 AUG 2019
 GOULBURN-MURRAY WATER
 40 CASEY STREET (PO BOX 165)
 TATURA VIC 3616
 Ph (03) 5833 5500 Fax (03) 58245827
 gmsupport@gmwater.com.au

Service Point Modernisation Action	Channel Modernisation Action	G-MW Irrigation Structures	Electrical Crossing	Offtake	Subway	Channel Network	Transport	Waterway	DCRP Customer Parcels
● Retain	— Retain channel with no modernisation	◆ Abandoned Structure	◆ Farm Irrigation Crossing	◆ Outfall	◆ Syphon	— Backbone	— Freeway	— Reservoir	■ DCRP Customer Parcels
● Relocate	— Retain channel with remediation	◆ Bridge	◆ Flume	◆ Pump Station	◆ Valve - Isolation	— Non-Backbone	— Highway	— Lake	■ Other Customer Properties
● Replace	— Retain channel with modernisation	◆ Culvert	◆ Footbridge	◆ Regulator	◆ Weir	- - - Decommissioned	— Major Road		■ Property/Land Not Serviced
● Rationalise	— Pipeline	◆ Drainage Inlet	◆ Monitoring Station	◆ Regulator Combine	◆ Proposed Pipeline	— Pipeline	— Semi-Major Road		
● Relocation Point	— Decommission channel					— Proposed Pipeline	— Minor Road		

SCALE AT A0 1:3,350

0 0.075 0.15 0.3 km

The content of this product is provided for information purposes only. No claim is made as to the accuracy or authenticity of the content of the product. In no event will G.M.W. its agents, instrumentalities and employees be liable for the accuracy of the information contained within this product nor its use of reliance placed on it. The information used within this product is provided on the basis that all persons accessing the information undertake responsibility for assessing the relevance and accuracy of its content.