



# Reconfiguration Plan: T032 RP15

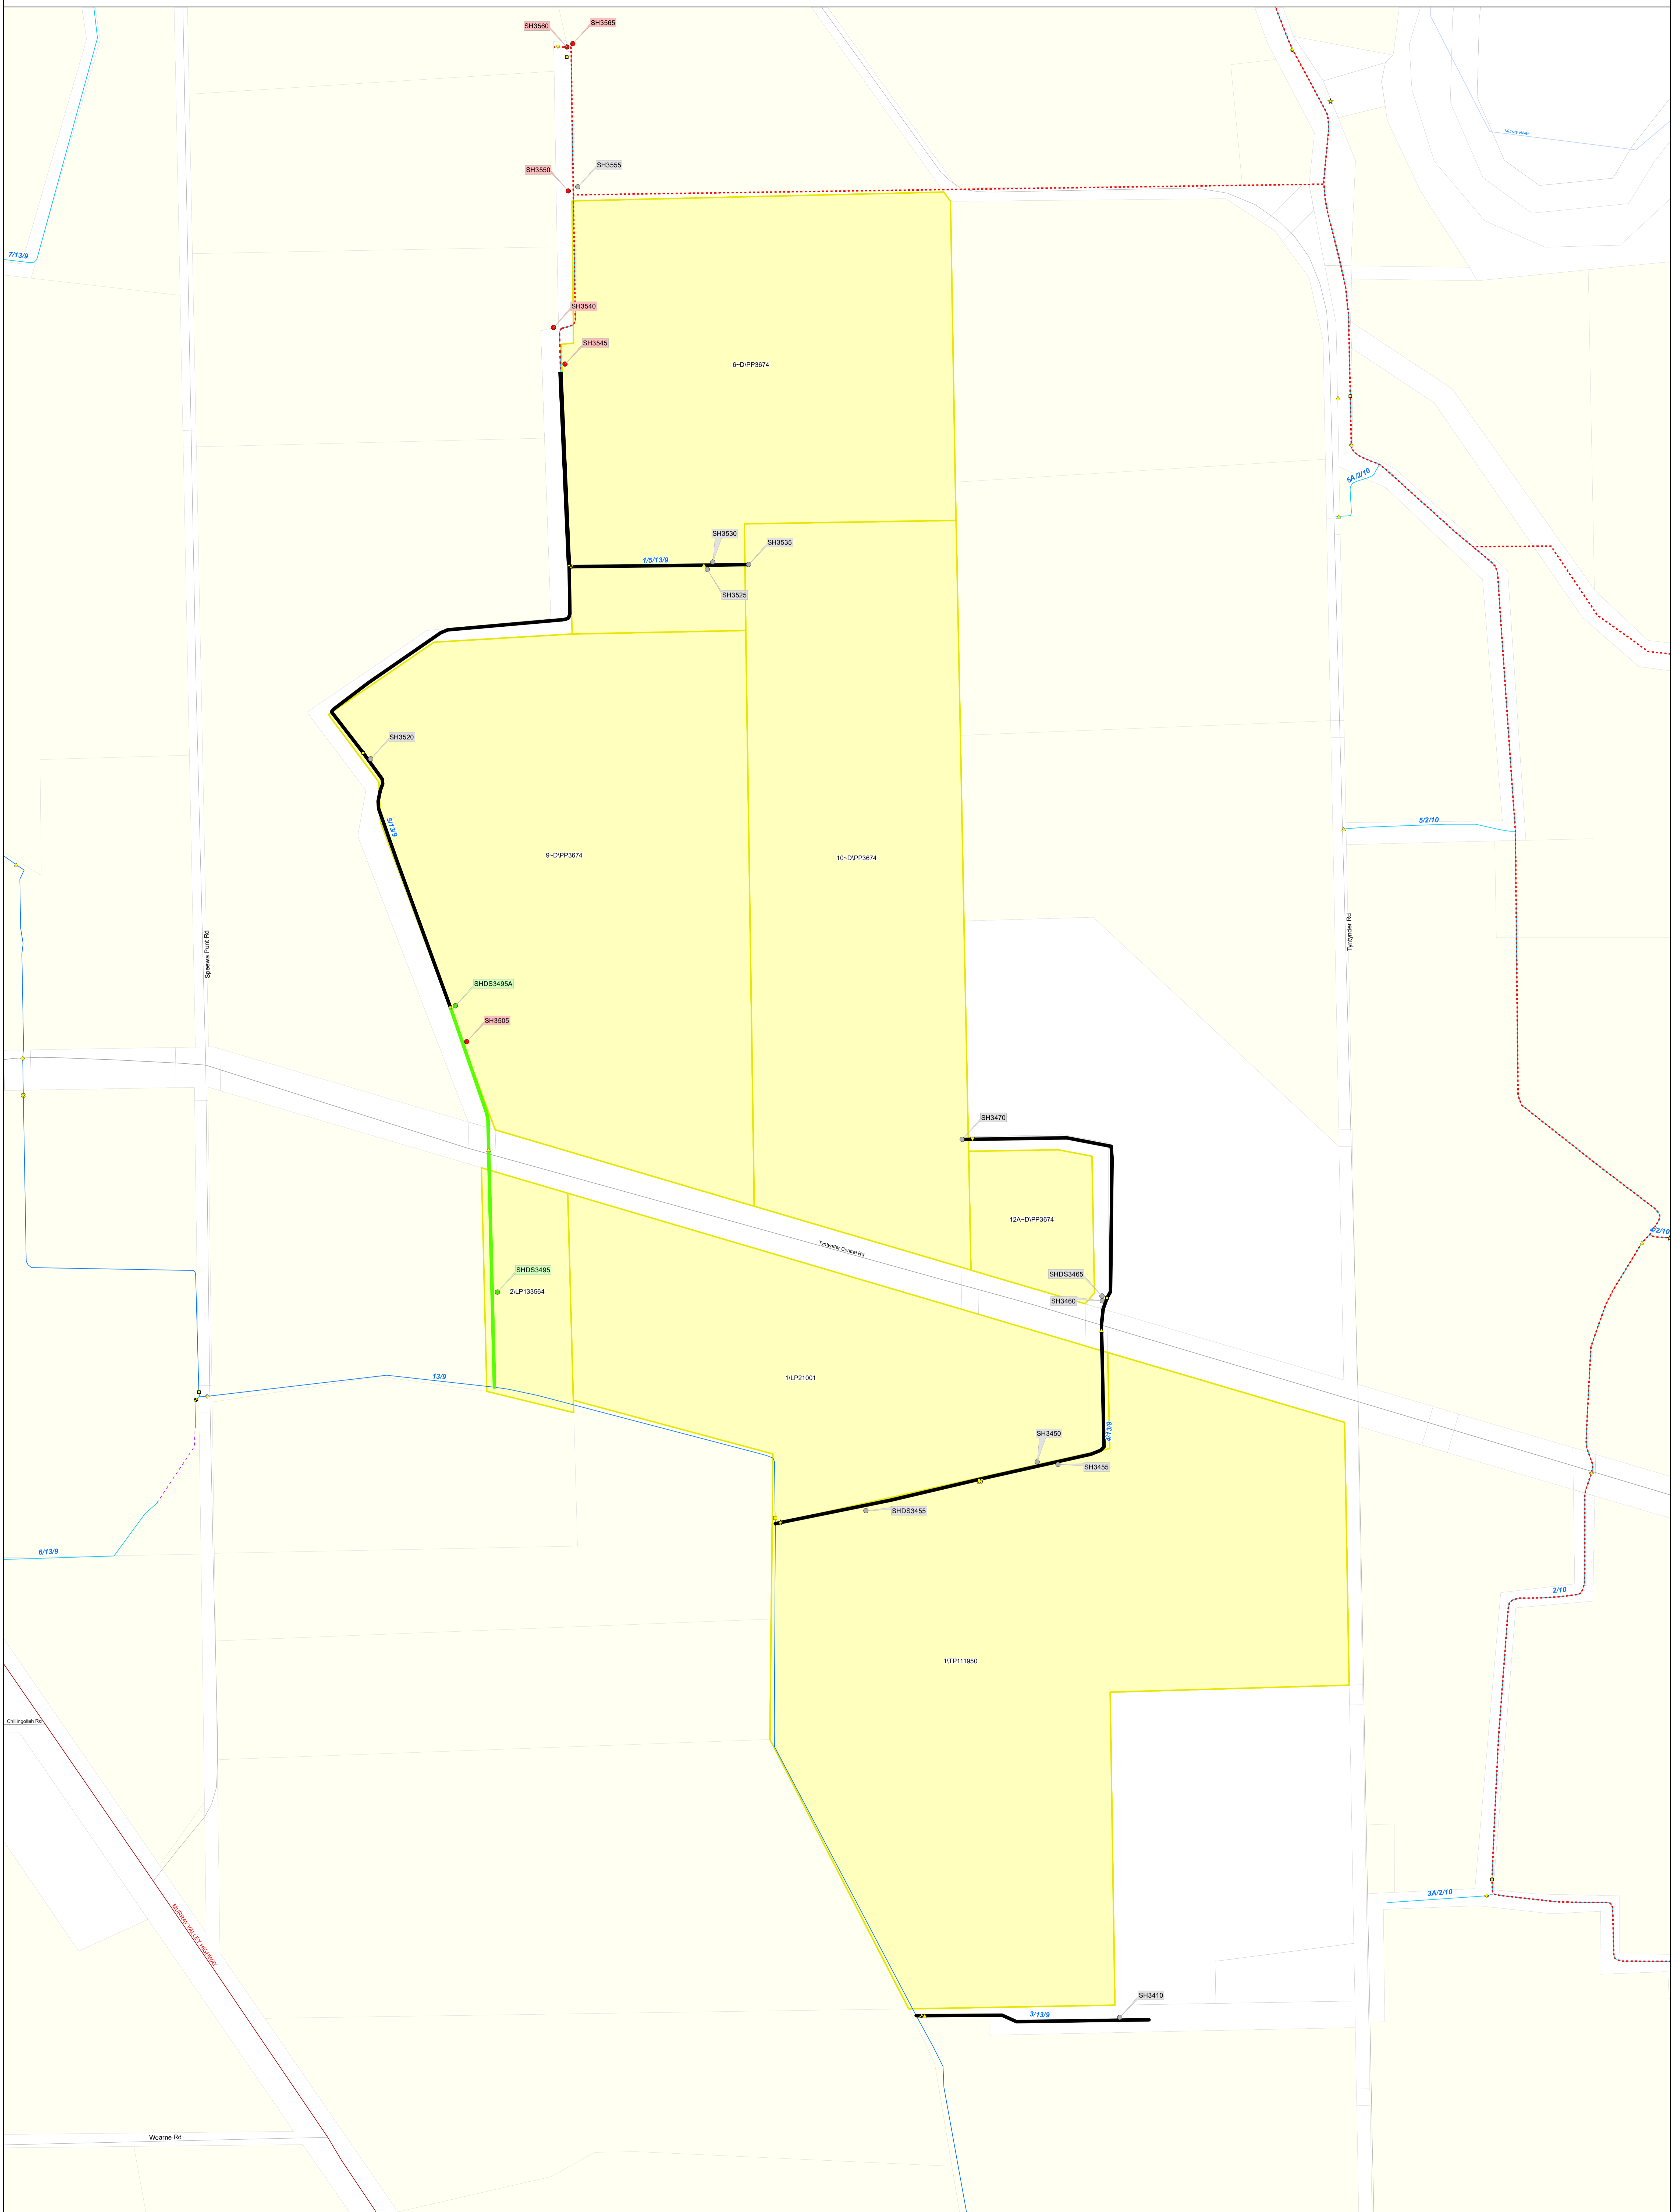

**IR185583**  
 28 JUN 2019  
 GOULBURN-MURRAY WATER  
 40 CASEY STREET (PO BOX 165)  
 TATURA VIC 3616  
 Ph (03) 5833 5500 Fax (03) 58245827  
 gmsupport@gmwater.com.au

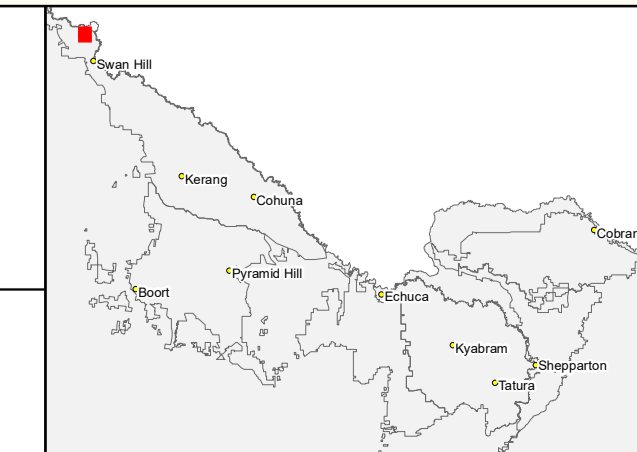

Service Point Modernisation Action	Channel Modernisation Action	G-MW Irrigation Structures	Electrical Crossing	Offtake	Subway	Channel Network	Transport
Retain	Retain channel with no modernisation	Abandoned Structure	Electrical Crossing	Offtake	Subway	Backbone	Freeway
Relocate	Retain channel with remediation	Bridge	Farm Irrigation Crossing	Outfall	Syphon	Non-Backbone	Highway
Replace	Retain channel with modernisation	Culvert	Flume	Pump Station	Valve - Isolation	Decommissioned	Major Road
Rationalise	Pipeline	Drainage Inlet	Footbridge	Regulator	Weir	Pipeline	Semi-Major Road
Relocation Point	Decommission channel		Monitoring Station	Regulator Combine		Proposed Pipeline	Minor Road

**SCALE AT A0 1:3,050**

0 0.075 0.15 0.3 km

The content of this product is provided for information purposes only. No claim is made as to the accuracy or authenticity of the content of the product. In no event will G-MW, its agents, instrumentalities and employees be liable for the accuracy of the information contained within this product nor its use of reliance placed on it. The information used within this product is provided on the basis that all persons accessing the information undertake responsibility for assessing the relevance and accuracy of its content.