


Commercial (CO) Series

Self-Regulating Cable for Roof and Gutter

120 and 240 VAC 6 Watts/Ft.
Above Standard Ratings are Heat
Output at 32°F for Roof and Gutter

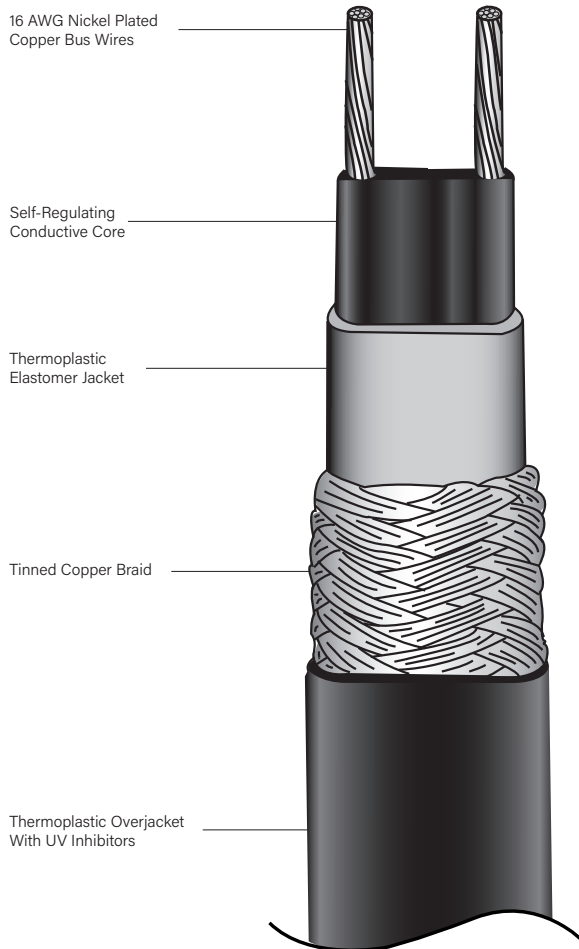

DESCRIPTION

Delta-Therm self-regulating heating cable increases heat output as temperature decreases, and conversely, decreases heat output as temperature increases. This cable is intended for roof and gutter applications.

Commercial Series cables contain two parallel bus wires electrically connected by a web of PTC (positive temperature coefficient) conductive polymer. A thermoplastic elastomer jacket surrounds the cable to provide mechanical protection and electrical isolation. The tinned copper braid provides additional mechanical protection as well as a ground path for fault currents. The thermoplastic (T) overjacket has UV inhibitors which protect against damage from the sun. The overjacket also provides mechanical protection.

APPLICATION

Roof And Gutter Deicing

APPROVALS

CSA Wet: CO Series CBT cables are CSA certified for roof and gutter applications (2E Cable Designation) when used with PCK-RGP Power Connection Kit.

UL Listed: CO Series CBT cables are UL Listed for roof and gutter de-icing.



WARNING: This cable must be installed by a qualified electrician. Improper installation can result in property damage, serious injury, and/or death due to electric shock and fires.

CO Series Technical Information

BREAKER SIZING AND MAXIMUM CIRCUIT LENGTH FT. (M)


Protective Device Rating		15A	20A	30A
Volts	Catalog Number			
120	CO 120-6	100' (30)	130' (40)	190' (58)
208	CO 240-6	200' (61)	260' (80)	380' (116)
240	CO 240-6	175' (54)	230' (70)	340' (104)
277	CO 240-6	150' (46)	190' (58)	285' (87)

ALTERNATE VOLTAGES

Delta-Therm 240V self-regulating heating cable is multi-voltage. It can be used in 208V, 240V, and 277V applications. (Please refer to the thermal rating row in the Electrical Specifications Table.)

CO SERIES ELECTRICAL SPECIFICATIONS

Catalog Number	CO120-6	CO240-6	CO240-6	CO240-6
Service Voltage	120	240	277	208
Maximum Circuit Length Ft. (m)	190' (58)	340' (104)	285' (87)	380' (116)
Thermal Rating at 32°F (°C) Watts/Ft. In Air (Watts/m)	6 (20)	6 (20)	7 (23)	5 (16)
Thermal Rating At 32°F (°C) Watts/Ft. In H₂O (Watts/m)	9 (30)	9 (30)	10 (33)	7 (26)
Maximum Exposure Temperature °F (°C)	185° (85°)	185° (85°)	185° (85°)	185° (85°)

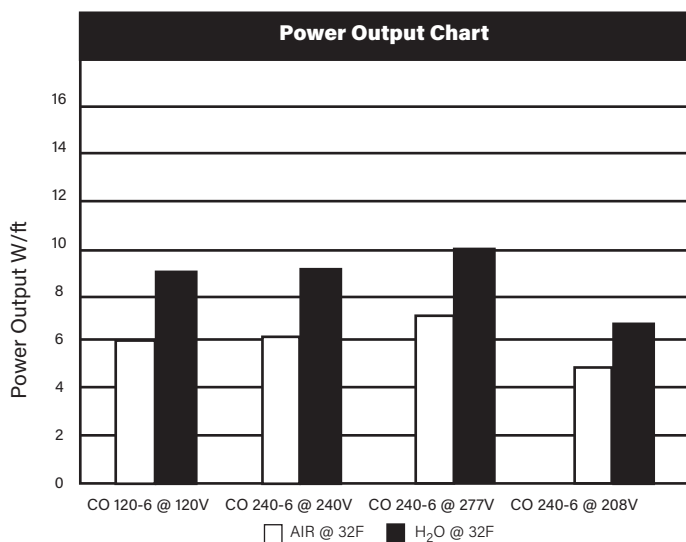

ACCESSORIES

PCK-RGP	Power Connection Kit
IMP	Ice Melt Panel
DT-AS-50	Roof Clips For Asphalt Or Metal Roofs (50 count)
RM-25-AL	Aluminum Clips For Metal Roofs (25 Count)
Specialty Clips	Specialty Clips Roof Materials Other Than Metal or Asphalt
DSH	Down Spout Hanger

CONTROLS

DTC24-R	Roof Deicing Control
MPS	Roof Deicing Control

PANELS

DT-XXPXXX	Enclosed Contactor Panel
GFPE-X-X	Power Control Panel w/ GFPE
LNR-X	Low Noise Relay Panel
Custom Control/Monitor/Alarm Panels	

CIRCUIT BREAKERS

Do not use magnetic-type circuit breakers. Delta-Therm recommends using the following thermal-magnetic circuit breakers (or equivalent) to prevent nuisance tripping caused by inrush currents:

Westinghouse:	Types BA, EB, EHB, FB, HFB
Gen. Electric:	Types TEB, THED
Square D:	Types EH, FA

USE OF GROUND FAULT PROTECTIVE DEVICES AND TINNED COPPER BRAID

NEC CODE 2017, ARTICLE 427-22:

Equipment Protection. Ground-fault protection of equipment shall be provided for electric heat tracing and heating panels. This requirement shall not apply in industrial establishments where there is alarm indication of ground faults and the following conditions apply:

- (1) Conditions of maintenance and supervision ensure that only qualified persons service the installed systems.
- (2) Continued circuit operation is necessary for safe operation of equipment or processes.

NEC CODE 2017, ARTICLE 427-23:

Grounded Conductive Covering. Electric heating equipment shall be listed and have a grounded conductive covering in accordance with 427.23(A) or (B). The conductive covering shall provide an effective ground path for equipment protection.

(A) Heating Wires or Cables. Heating wires or cables shall have a grounded conductive covering that surrounds the heating element and bus wires, if any, and their electrical insulation.

The metal covering shall provided an effective ground path.

The material contained in this document is presented in good faith and believed to be reliable and accurate. However, because testing conditions may vary and material quality or information that may be provided in whole or in part by others may be beyond our control, no warranty, expressed or implied, is given. Delta-Therm can assume no liability for results obtained or damages incurred through the application of the data and tests presented.

