


)HN LH F 0C 4L CHAF MM G FS -CH L F )HMOF N - )

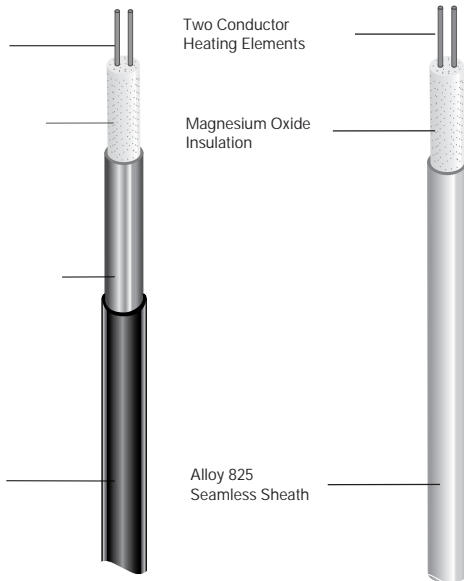

# - 3. \$\$ #\*0' /- 3/ -)"4/\*  
 +(\$)"\$\*V# '\$2\$#\*0/- (\*1\$/#  
 # / - \$21 -!.. 3\$ \$0-\$ \$\$. -)'  
 /-\$2\$1 3-). \$31/\$) 1\*\$  
 - (\*1\*\$0/\$ \$ - \*0-.»

/\*.. '0'/\$) - /# (. 2\$# 3/ -)'  
 \$-\$' /#\*0"# 3.. \$' /"2 #  
 # / -)' /#(0./ (/#/# \$)"/#./#  
 # / - \$" \$' /# \$ 3..)'\*) /  
 0. \$.) 0(-0./ /- 3/ -)"4»

0Y) \*) /\*-.. 0\$ / \*  
 +\*1\$ '\$\$/\$' /.' 2# - /# /# - (" - \$/  
 . /\$ (- .!\*( /# \$ \$\*0/0/  
 )-)" !\*( / \*2//.+ \$-!\*/Üj  
 2//.+ \$- ( / - Y 0/0/(4  
 # \$ - /#) - 0\$ 0 / \* - ./ - \$ \$) .0#.  
 1\*/ /" ) ' ')" /#Y

" . . )4

- MS )HMN FF 0OFFCHA S IL MS )HMN FF NC
- ONIG NC H F
- 2 GIP F 2 F F )H S L M 7CNB  
-CHCGOG IHMNLO NCIH

00,) 4) .


- Any "Hard-To Get-At" Areas
- Closed Hose Bibs
- Freeze Protection
- Limited Access Piping
- Prisons
- Outdoor Drains

\* The system should be controlled by a thermostat.





Warning: Pulsating conditions may cause fatigue failure. Do not pull through valves or pumps. More than 45° of bend in a pipe may cause cable to bind during installation. Fitting may require soft solder "sweating" to maintain watertight connection. System must be grounded.

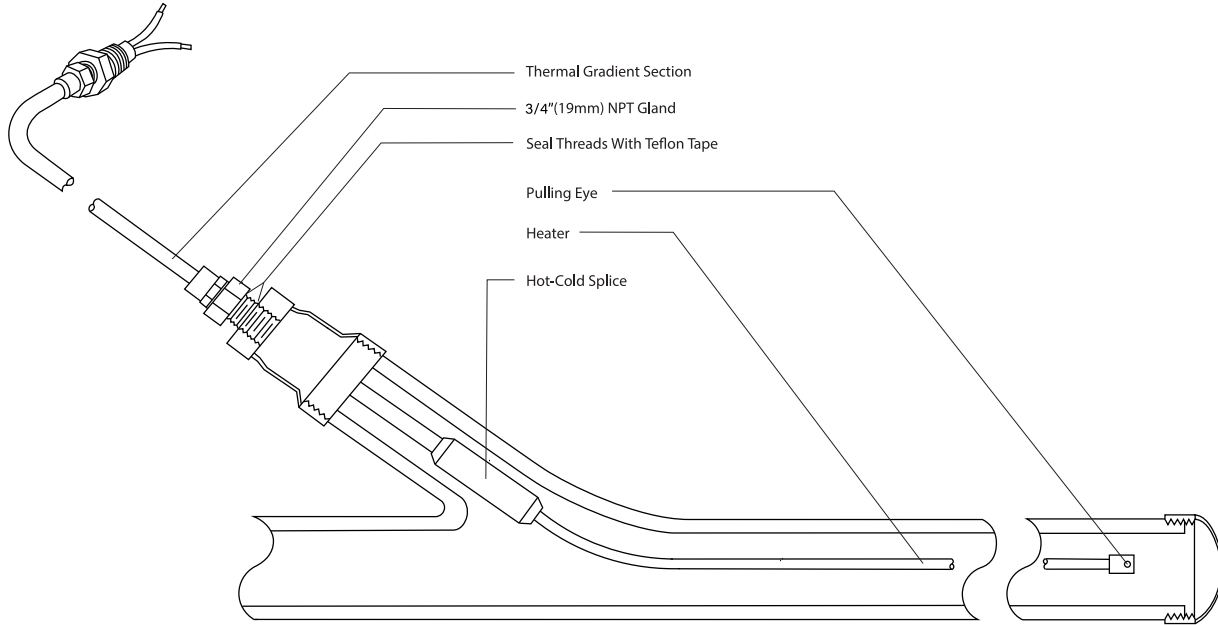

Detail 1. Typical Detail For Internal Tracing/Metal Pipes.

### INVENTORY AND SHIPPING

Delta-Therm maintains an inventory of both bare and jacketed mineral insulated cable. Orders of material in stock can usually be shipped within two weeks.

<b>to order:</b>	P														
<b>prefix</b> _____ (P - Pipe Tracing)	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑	↑
<b>number of conductors</b> _____															
<b>ohms/Ft. (m)</b> _____															
<b>length per Hot section</b> _____ (measurement in feet)															
<b>Volts</b> _____															
<b>amps</b> _____															
<b>kw</b> _____															
<b>watts per linear Foot</b> _____ (refer to design guide)															
<b>suffix H, b, or ss</b> _____ (if desired)															
<b>awg</b> _____ (refer to chart)															
<b>cold length</b> _____ (length needed to reach junction box NOTE: voltage drop not to exceed 3%)															